

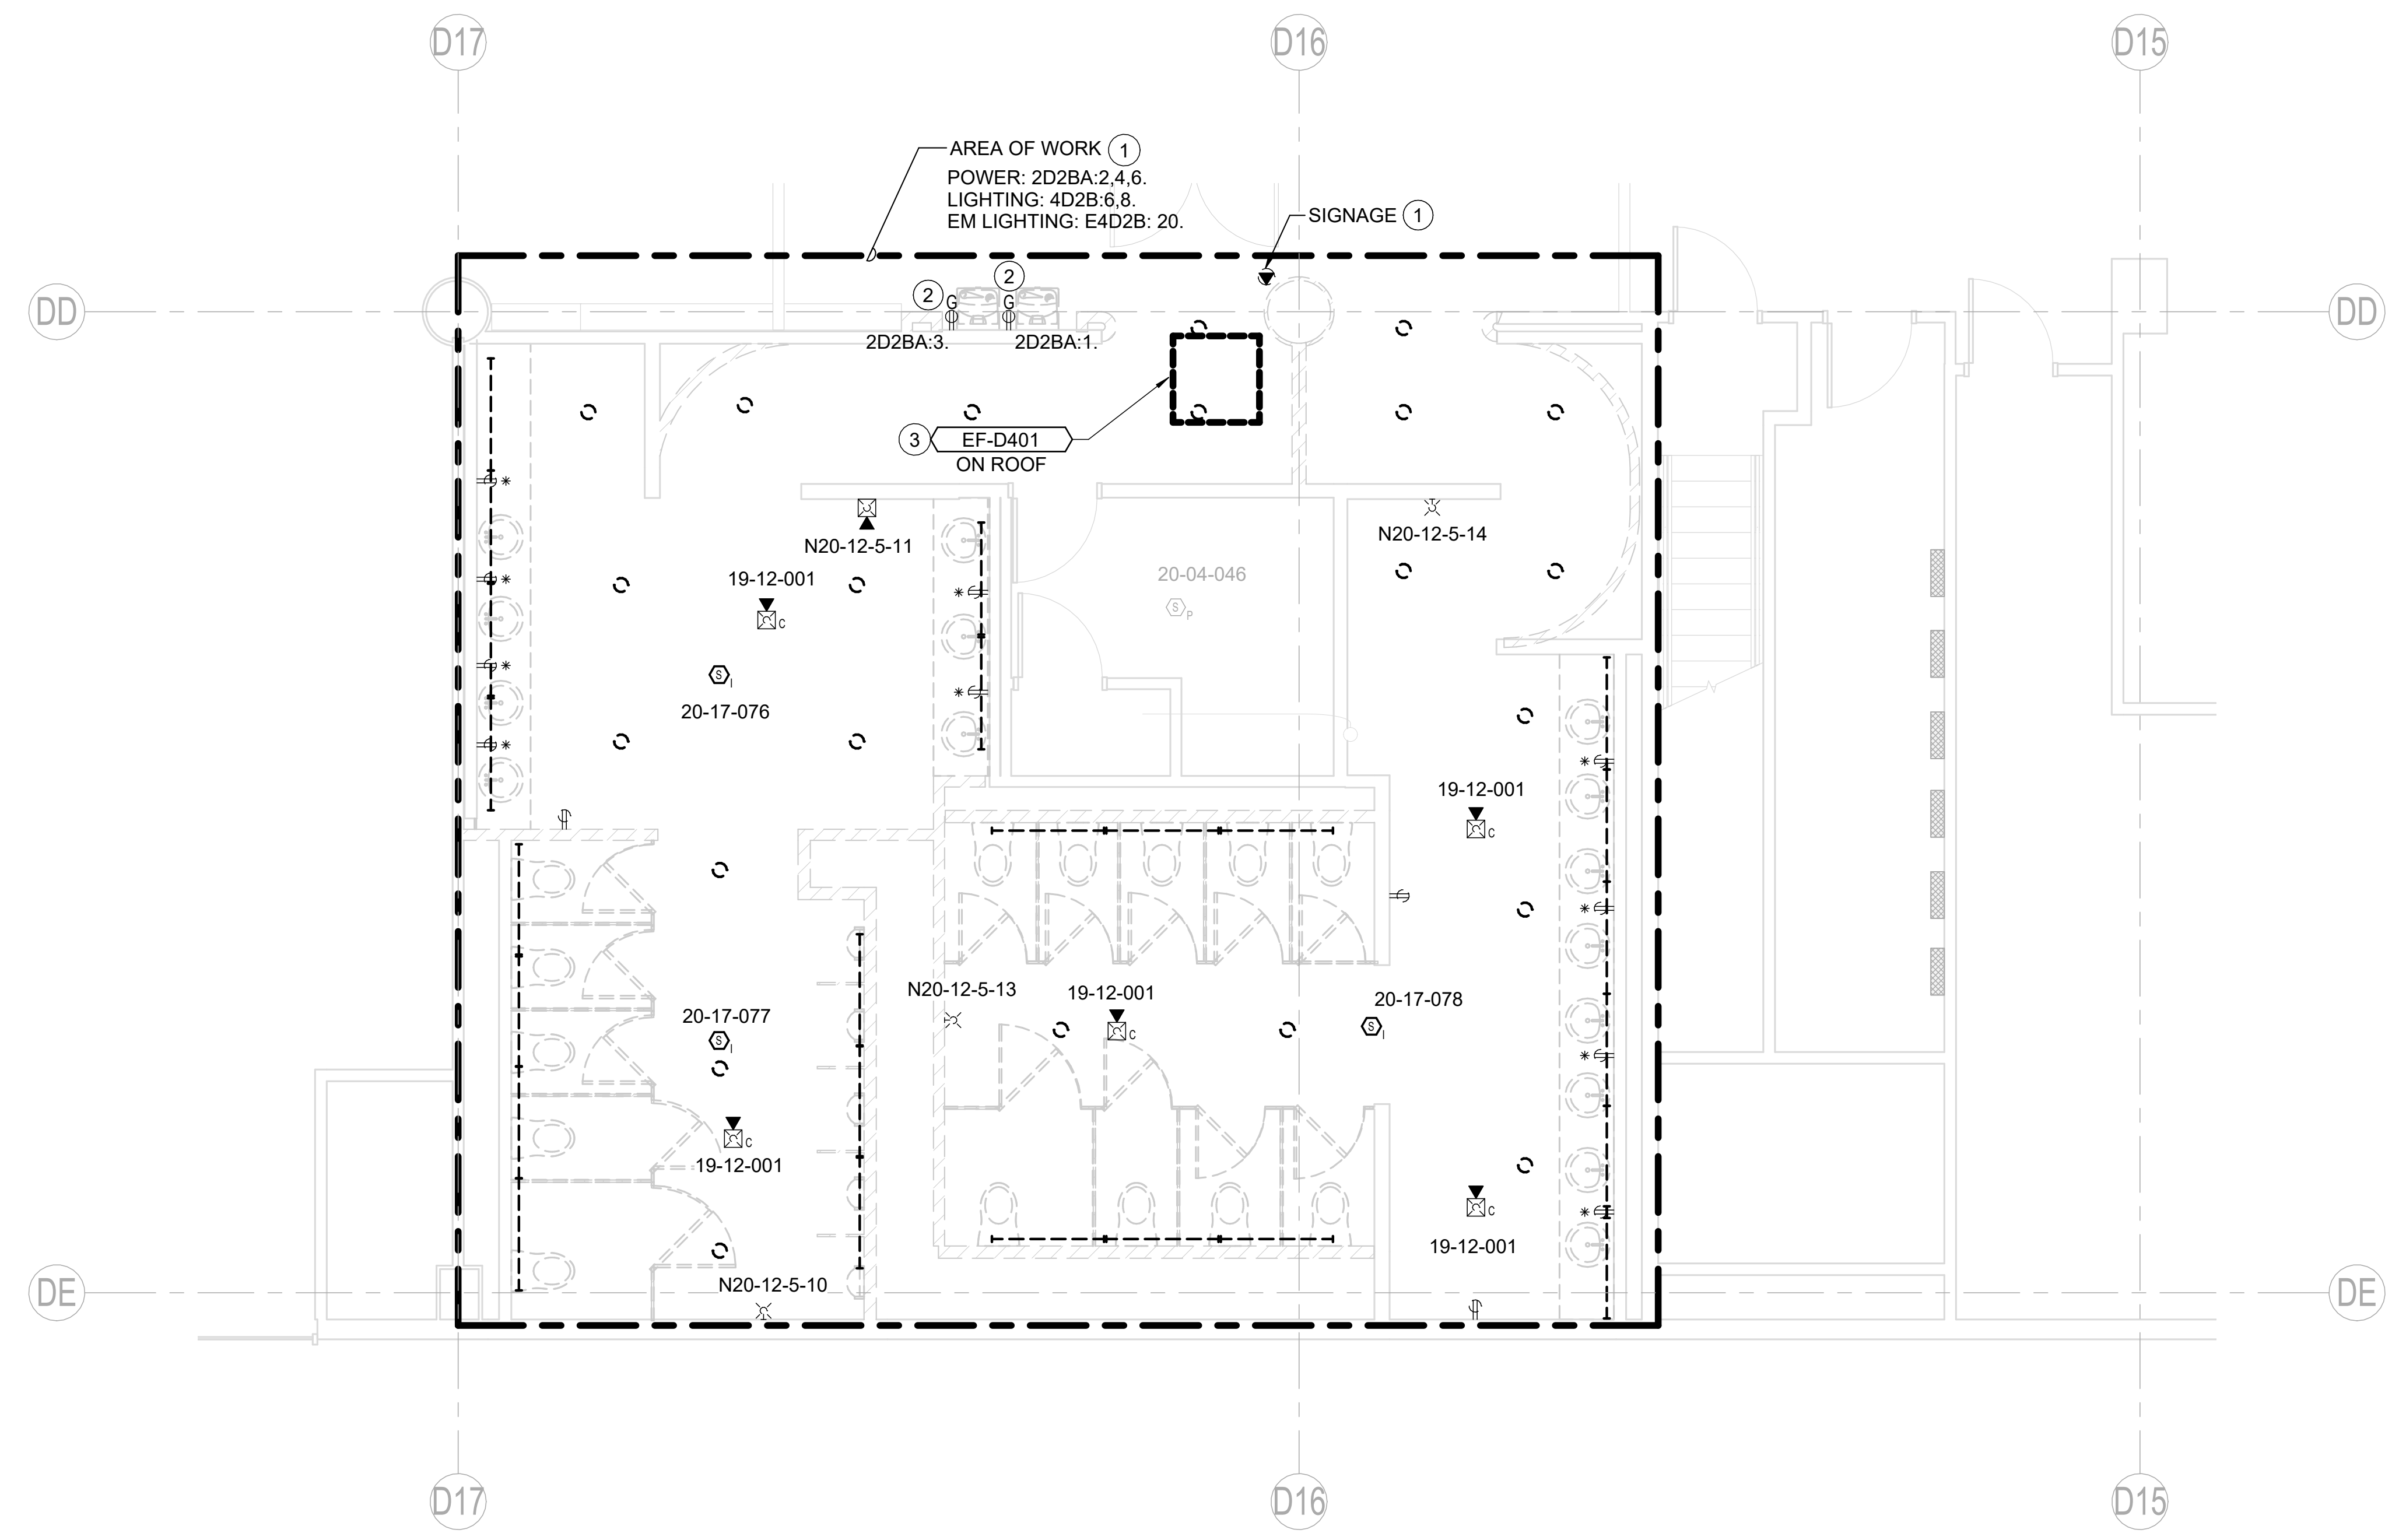


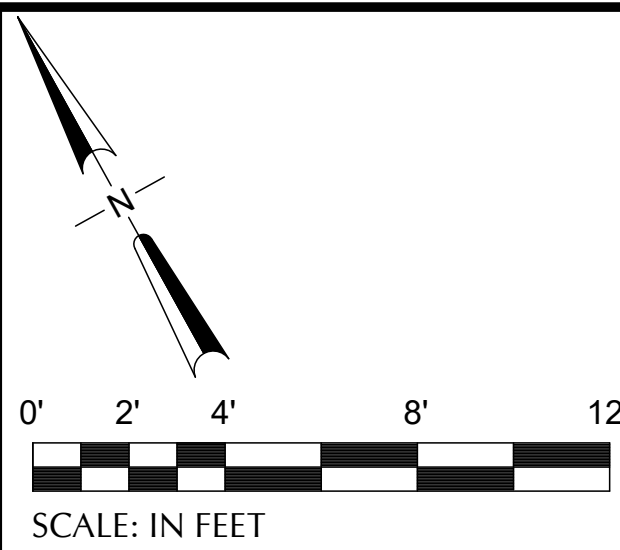

- # NOTES
1. LOCATIONS SHOWN FOR DEVICES, EQUIPMENT, LUMINARIES AND ENCLOSURE ARE DIAGRAMMATIC AND INFORMATION HAS BEEN DETERMINED FROM AS-BUILT DOCUMENTS AND SITE OBSERVATIONS. CONTRACTOR TO FIELD VERIFY DURING PRE-BID WALK AND IDENTIFY COMPLETE SOW FOR DEMOLITION.
 2. ALL RECEPTACLES, EQUIPMENT, LUMINARIES AND DEVICES ARE TO BE REMOVED IN AREA OF WORK UNLESS OTHERWISE NOTED.
 3. WHERE DEMOLITION IS SPECIFICALLY NOTED: THAT EQUIPMENT, DEVICE, LUMINAIRE, ETC AND IT'S BRANCH CIRCUIT SHALL BE REMOVED IN ITS ENTIRETY BACK TO THE PANEL OR LAST ACTIVE UPSTREAM DEVICE UNLESS OTHERWISE NOTED. PROVIDE CONDUIT AND CONDUCTORS TO MAINTAIN CONNECTION TO ALL DOWNSTREAM DEVICES THAT REMAIN.
 4. MAINTAIN THE INTEGRITY OF ALL BRANCH CIRCUITS, FEEDERS, ENERGIZED EQUIPMENT, ETC THAT ROUTE THROUGH DEMOLITION AREAS AND SERVE EQUIPMENT TO REMAIN.

- ## KEY NOTES #
1. DISCONNECT AND REMOVE ALL LIGHTING, SIGNAGE AND ASSOCIATED BRANCH CIRCUITS. REFEED NEW THROUGH RELAY PANELS - SEE E2.01. DISCONNECT AND REMOVE ALL DEVICES, MAINTAIN CIRCUITS FOR REUSE
 2. DISCONNECT EWC AND DEMOLISH DEVICE PRESERVE CIRCUIT FOR EXTENSION TO NEW LOCATION SHOWN ON SHEET E3.01.
 3. DISCONNECT EXISTING EXHAUST FAN AND SAVE BRANCH CIRCUIT FOR REUSE

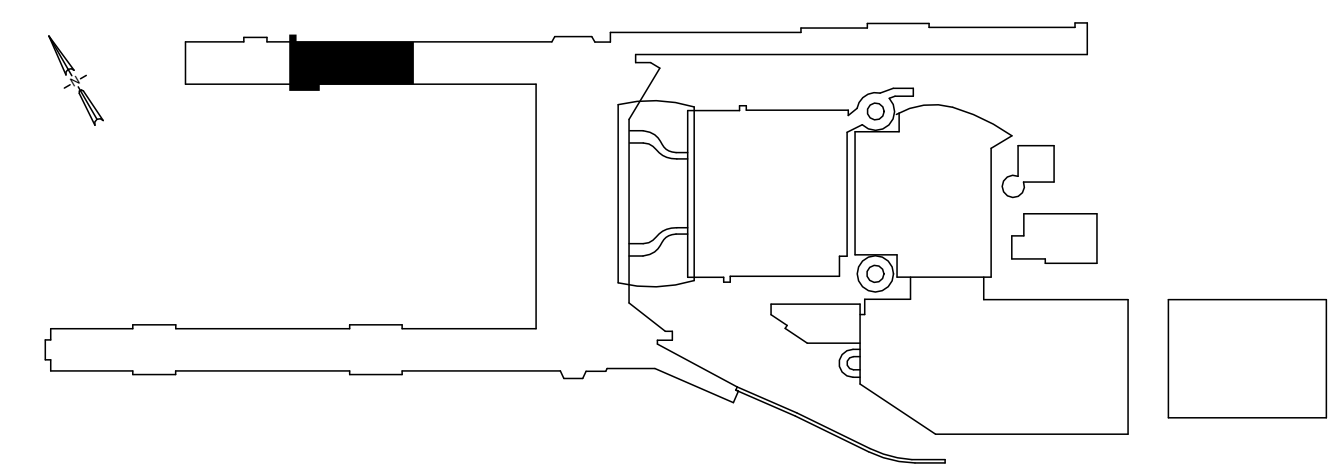

1 CONOURSE D - SECTOR 2 - D2221, D2222, D2223 - ENPLANING - DEMO PLAN - ELECTRICAL
SCALE: 1/4" = 1'-0"

[illegible]

IF ELECTRONIC SIGNATURE IS BROKEN OR MISSING - THIS IS NOT A LEGAL DRAWING

DRAWING SCALE IS REDUCED 50% WHEN SHEET SIZE IS 11" x 17".