
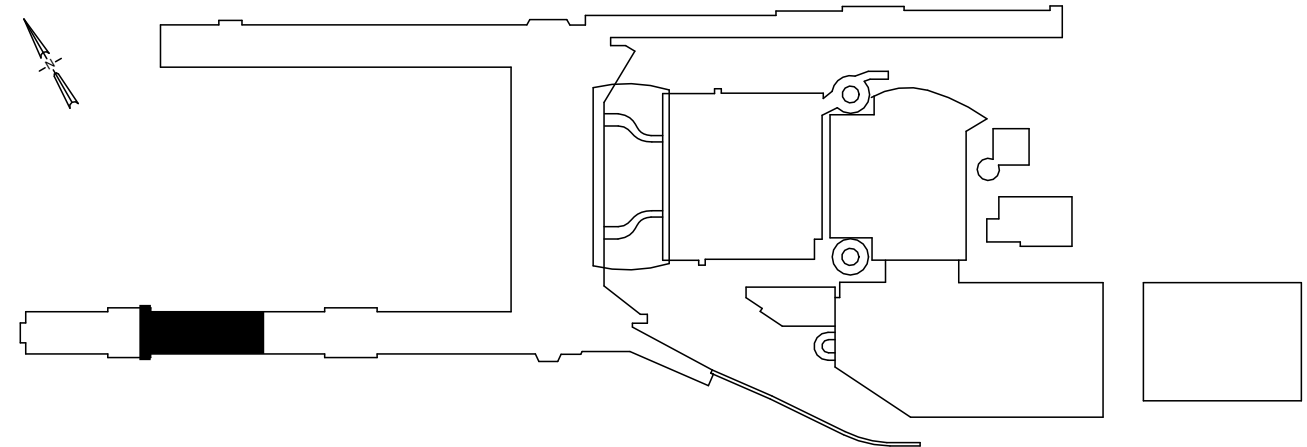


GRAPHIC SCALE FOR REFERENCE ONLY

0 1/4" 1/2" 1" 2"

DRAWING SCALE IS REDUCED 50% WHEN SHEET SIZE IS 11" x 17"

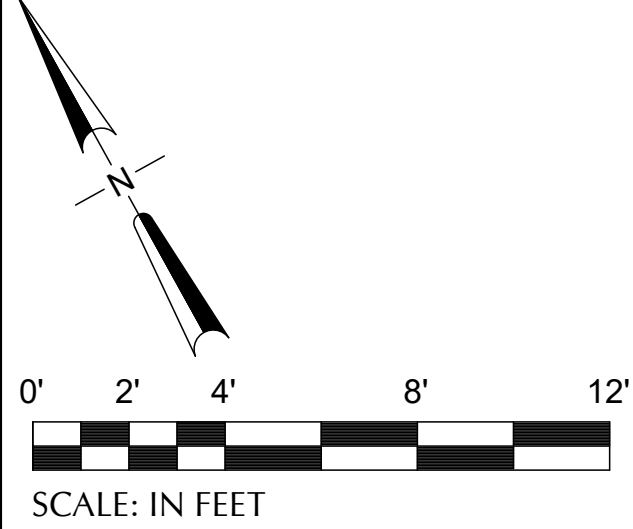

KEY NOTES

1. CONNECT TO CIRCUIT 4C3B CIRCUIT 7 AND CONTROL SHOWN.
2. PROVIDE LINE VOLTAGE SWITCH AND CONNECT TO 4C3B CIRCUIT 7. EXTEND SWITCH LEG AS SHOWN.
3. ROOM CONTROLLER ABOVE CEILING WITH NORMAL AND EMERGENCY RELAYS AND INTEGRAL UL 924 TRANSFER. SEE SPECIFICATIONS.
4. CONNECT SIGNAGE TO EXISTING CIRCUIT VIA ROOM CONTROLLER.

1 CONOURSE C - SECTOR 5 - C2039 - ENPLANING - RCP - LIGHTING
SCALE: 1/4" = 1'-0"

[illegible]

 Port of Portland		
 mwa architects	 PAE pae-engineers.com 151 SW 1st Avenue #300 Portland, OR 97204 503.226.2921 pae-engineers.com	
_____ 2025D031 DESIGN NUMBER	_____ 103101 PROJECT NUMBER	7/14/26 EXPIRES: 12/31/2026

PORTLAND INTERNATIONAL AIRPORT TERMINAL RESTROOM REHABILITATION 2026 CONCOURSE C - ENPLANING - SECTOR 5 - C2039 - RCP - LIGHTING	SUBMITTED BY	BRIAN FRANCIS	
	DESIGNED BY	A. NGUYEN	
	DRAWN BY	A. NGUYEN	
	CHECKED BY	J. MUTSCHLER	
	DATE	JULY 2026	
	SHEET NO.	122	TYPE CD
	DRAWING NO.	PDX 2026-510	DISC. SHT. NO. E2.00