
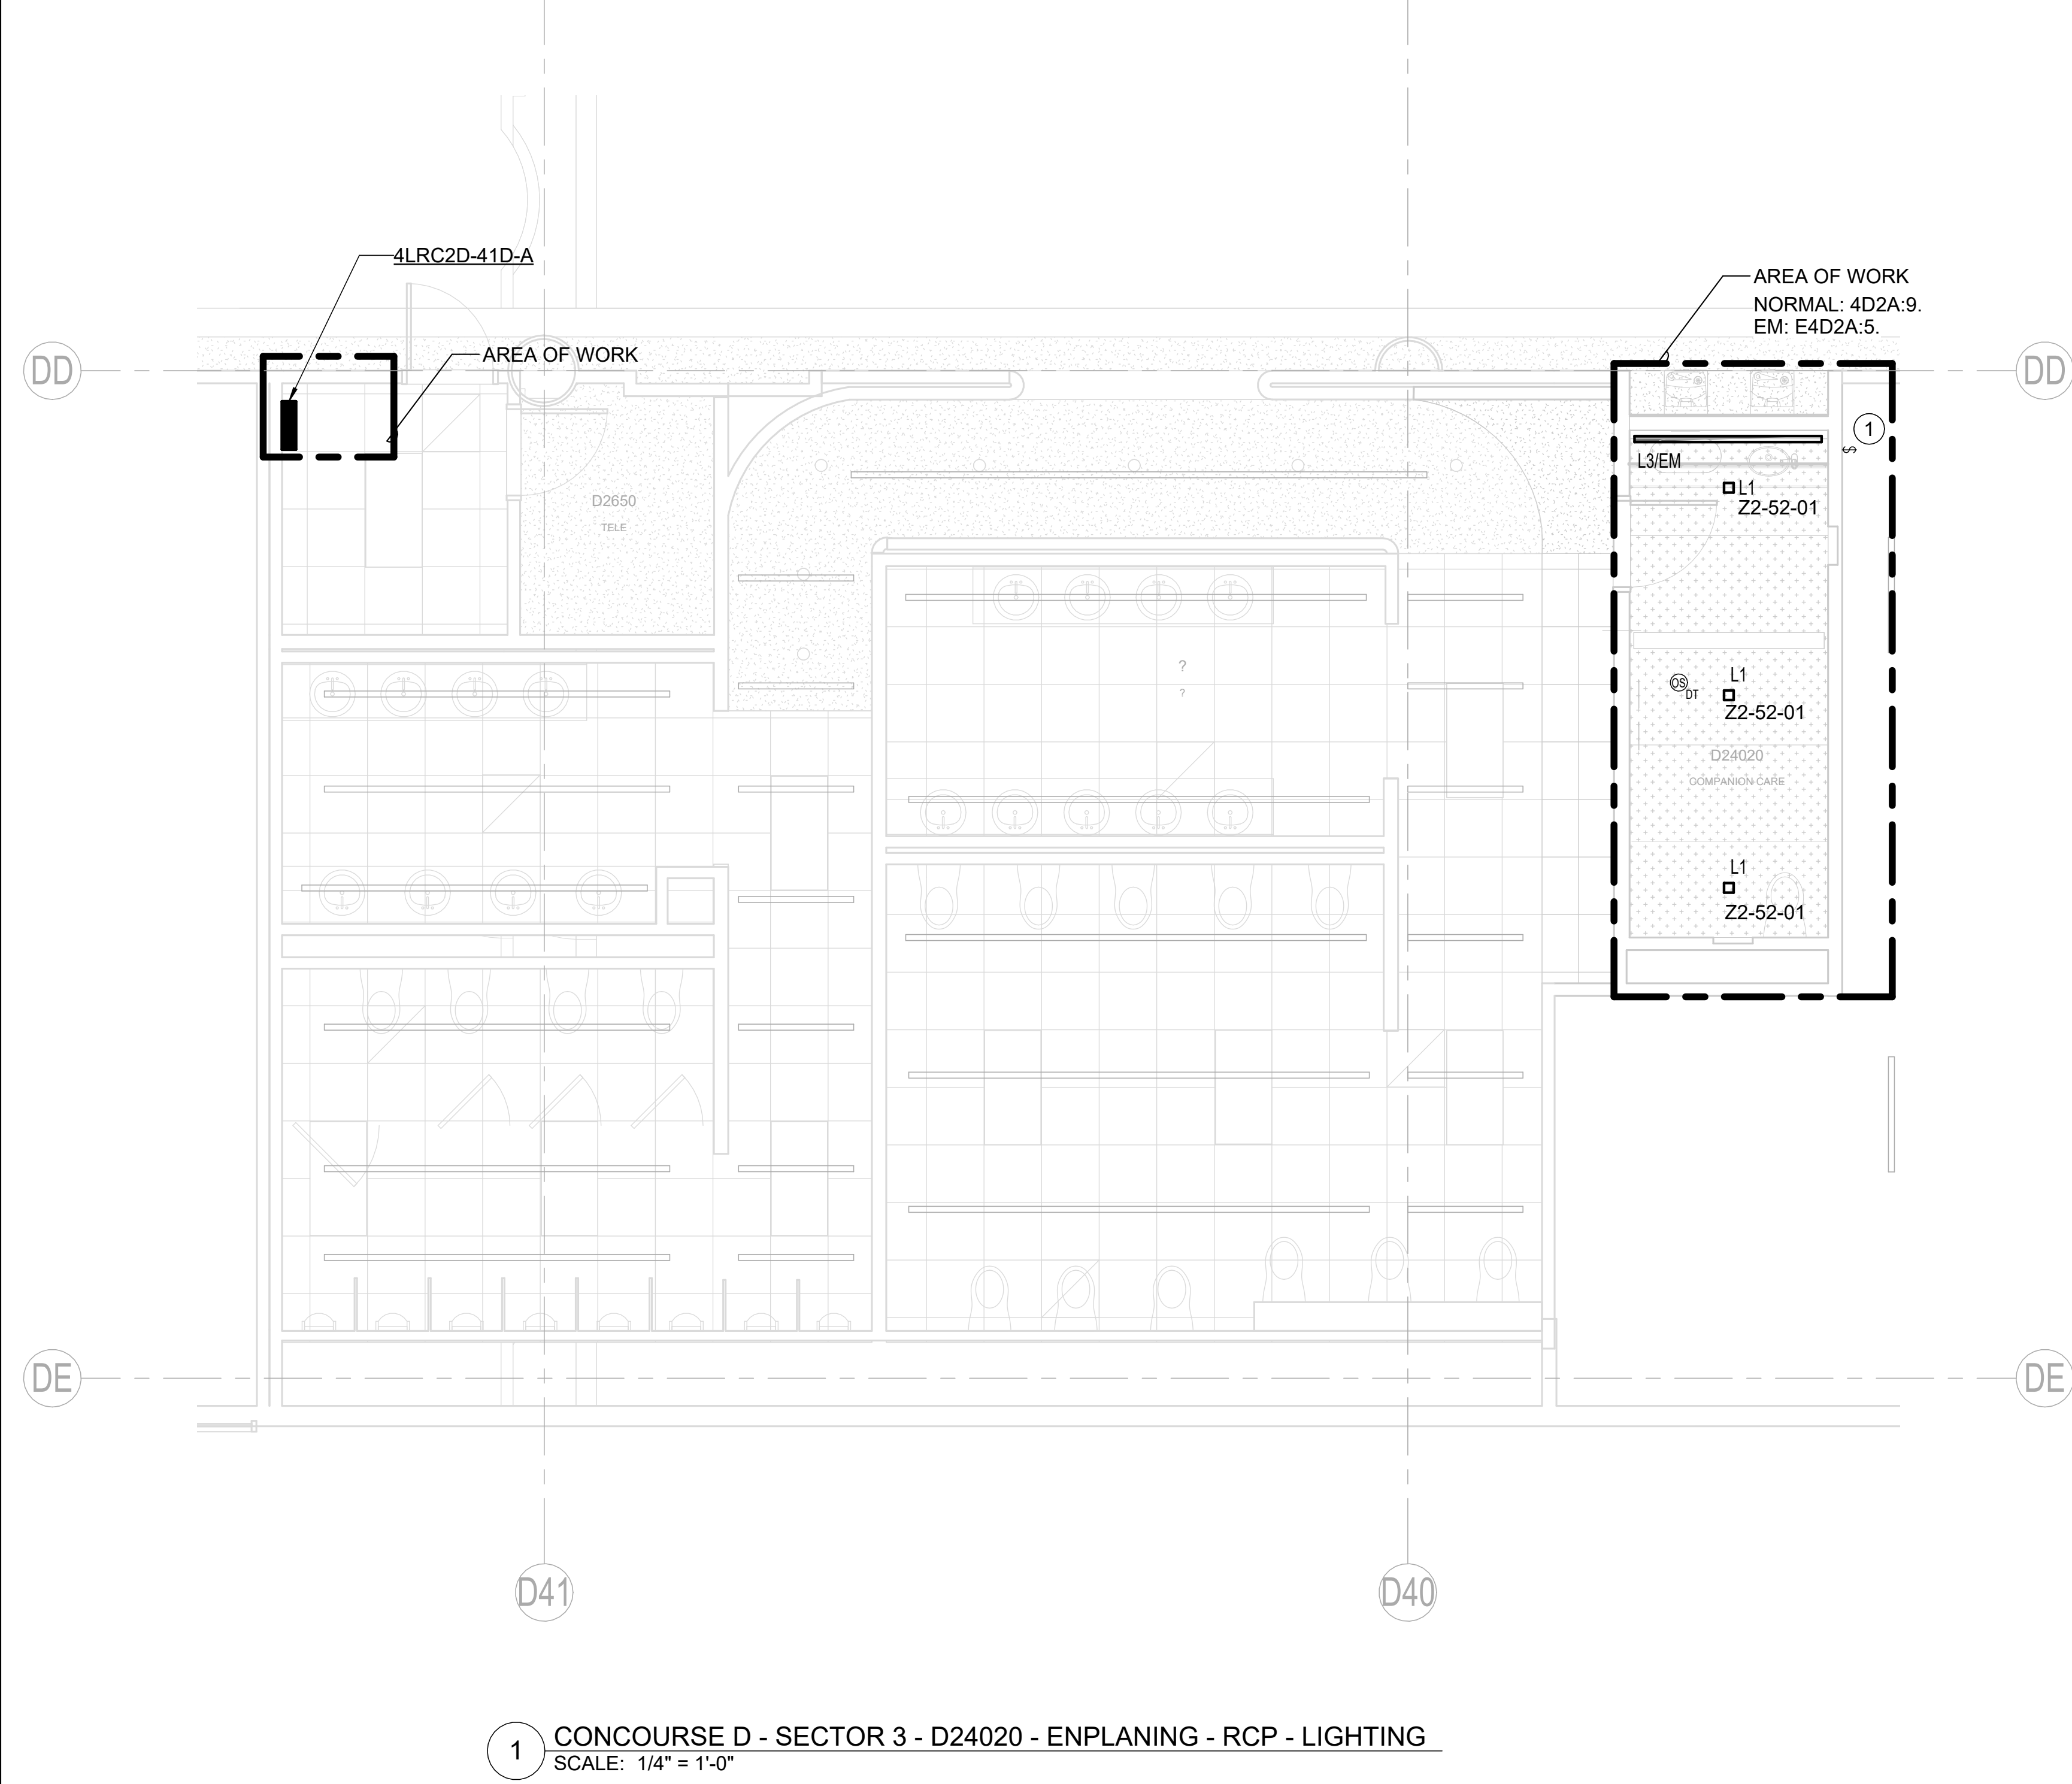


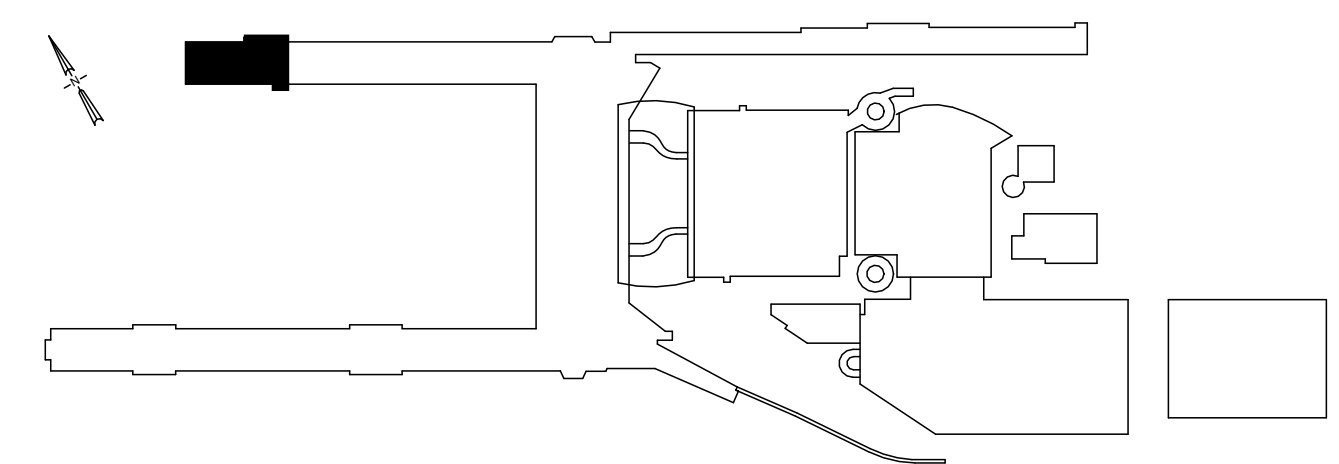

- ## NOTES
1. ALL EQUIPMENT SHOWN IS NEW UNLESS OTHERWISE NOTED.
 2. DOWNLIGHTS TO BE CENTERED IN THE ARCHITECTURAL PANEL.
 3. L3 LIGHTS TO BE SUSPENDED FROM STRUCTURE AND CENTERED IN ARCHITECTURAL COVE.
 4. RELAY ZONES INDICATED HOMERUN TO LIGHTING RELAY PANEL 4LRC2D-41D-A. REFER TO LIGHTING CONTROL SCHEDULE SHEET E7.02 FOR CIRCUITING INFORMATION.
 5. ROUTE 0-10V DIMMING CONDUCTORS FROM LRC TO RESTROOM LIGHTS SHOWN IN LIGHTING CONTROL SCHEDULE FOR DIMMING CONTROL .

KEY NOTES

1. PROVIDE NEW SWITCH FOR CONTROL OF LIGHTING IN FUTURE TENANT SPACE, RECONNECT SWITCHLEG REMOVED IN DEMOLITION

[illegible]