

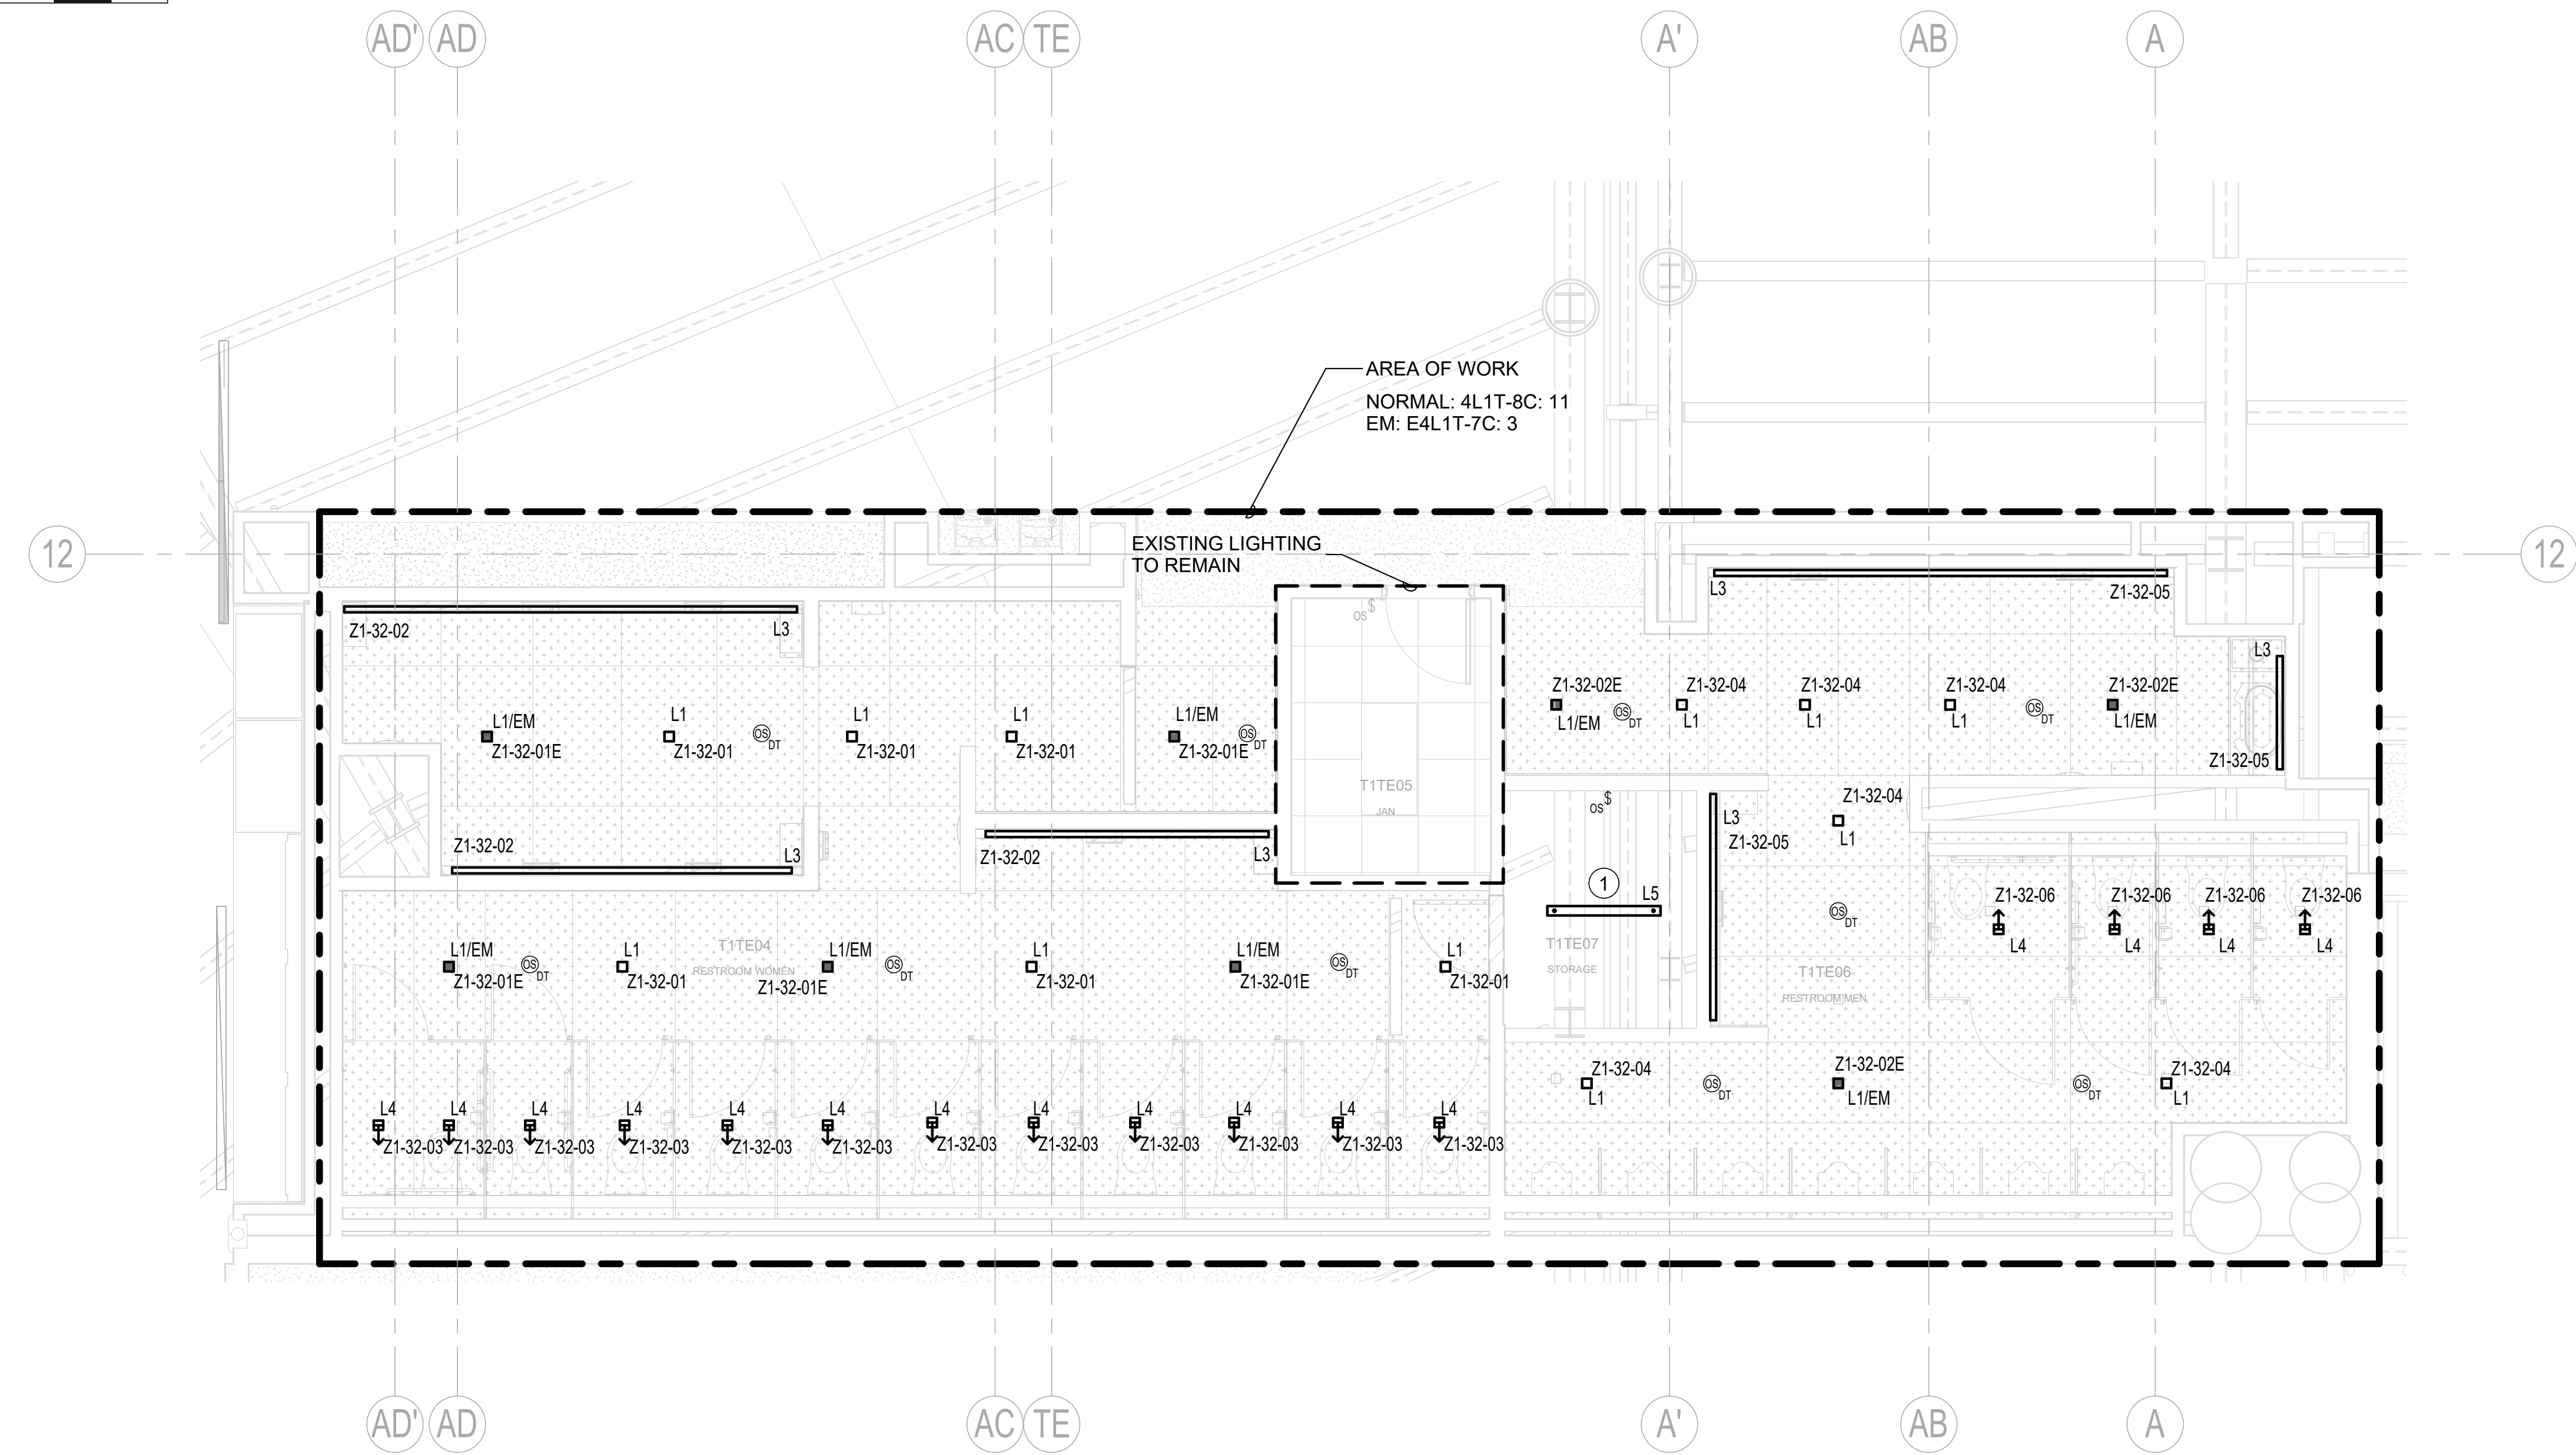


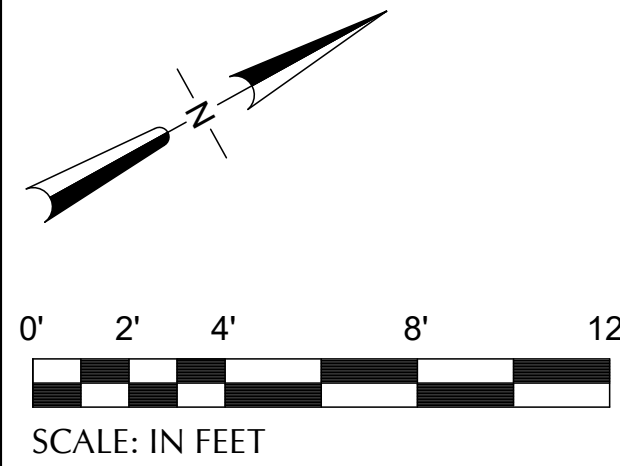

- ## **NOTES**
1. ALL EQUIPMENT SHOWN IS NEW UNLESS OTHERWISE NOTED.
 2. DOWNLIGHTS TO BE CENTERED IN THE ARCHITECTURAL PANEL.
 3. L3 LIGHTS TO BE SUSPENDED FROM STRUCTURE AND CENTERED IN ARCHITECTURAL COVE.
 4. RELAY ZONES INDICATED HOMERUN TO LIGHTING RELAY PANEL 4DC1T-13G-B IN ELECTRICAL ROOM T1TF33. REFER TO LIGHTING CONTROL SCHEDULE SHEET E7.03 FOR CIRCUITING INFORMATION.
 5. ROUTE 0-10V DIMMING CONDUCTORS FROM LRC TO RESTROOM LIGHTS SHOWN IN LIGHTING CONTROL SCHEDULE FOR DIMMING CONTROL .

KEY NOTES

1. CONNECT NEW LIGHT FIXTURE TO 4L1T-8C CIRCUIT 11.

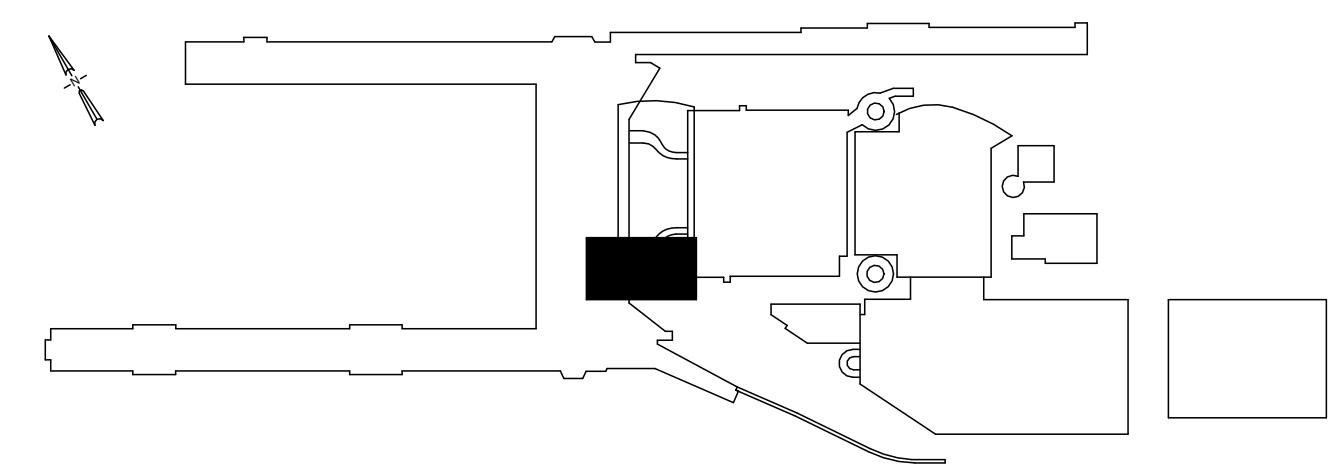

1 TERMINAL - SECTOR E5 - T1TE04, T1TE05, T1TE06, T1TE07 - DEPLANING - RCP - LIGHTING
SCALE: 1/4" = 1'-0"

[illegible]