

The diagram illustrates a 480V distribution system. On the left, a **DISTRIBUTION PANELBOARD** (E4SDP) is shown with a 400A, 480Y/277V, 3PH, 4W rating. It has two outgoing feeders: one labeled **E4D2B** and another labeled **E4D2A**. Both feeders are enclosed in a dashed box labeled **AREA OF WORK**. The feeder E4D2A is connected to a **BUSWAY D1** (1000A 480Y/277V, 3PH 4WIRE). The busway is connected to a **UNIT SUBSTATION** (TDB). The unit substation includes a transformer (4T1T-7C, 45 KVA, 480V-208Y/120V) and a circuit breaker (4D2A). The unit substation is also enclosed in a dashed box labeled **AREA OF WORK**. The unit substation is connected to a **200AF 250AS** feeder, which is connected to a **2D2A** feeder. The 2D2A feeder is also enclosed in a dashed box labeled **AREA OF WORK**.



mwa architects



Port of Portland




PAE
pae-engineers.com

151 SW 1st Avenue #300
Portland, OR 97204

503.226.2921
pae-engineers.com

2025D031 _____ DESIGN NUMBER	103101 _____ PROJECT NUMBER
------------------------------------	-----------------------------------

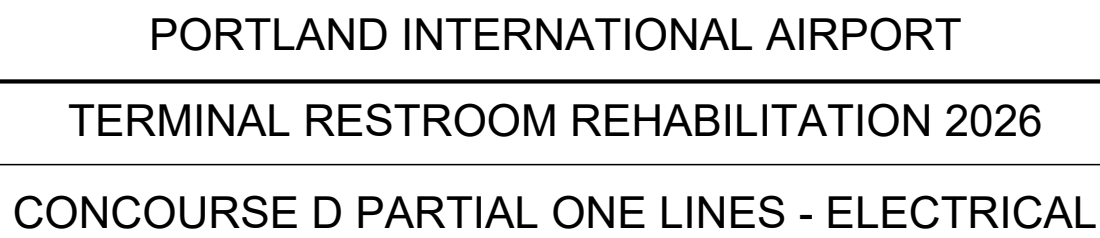

SUBMITTED BY	BRIAN FRANCIS		
DESIGNED BY	A. NGUYEN		
DRAWN BY	A. NGUYEN		
CHECKED BY	J. MUTSCHLER		
DATE	JULY 2026		
SHEET NO.	170	TYPE	CD
DRAWING NO.	PDX 2026-510		DISC SHT. NO. E9.02